


Typical Dryer Vent

WM 6.1

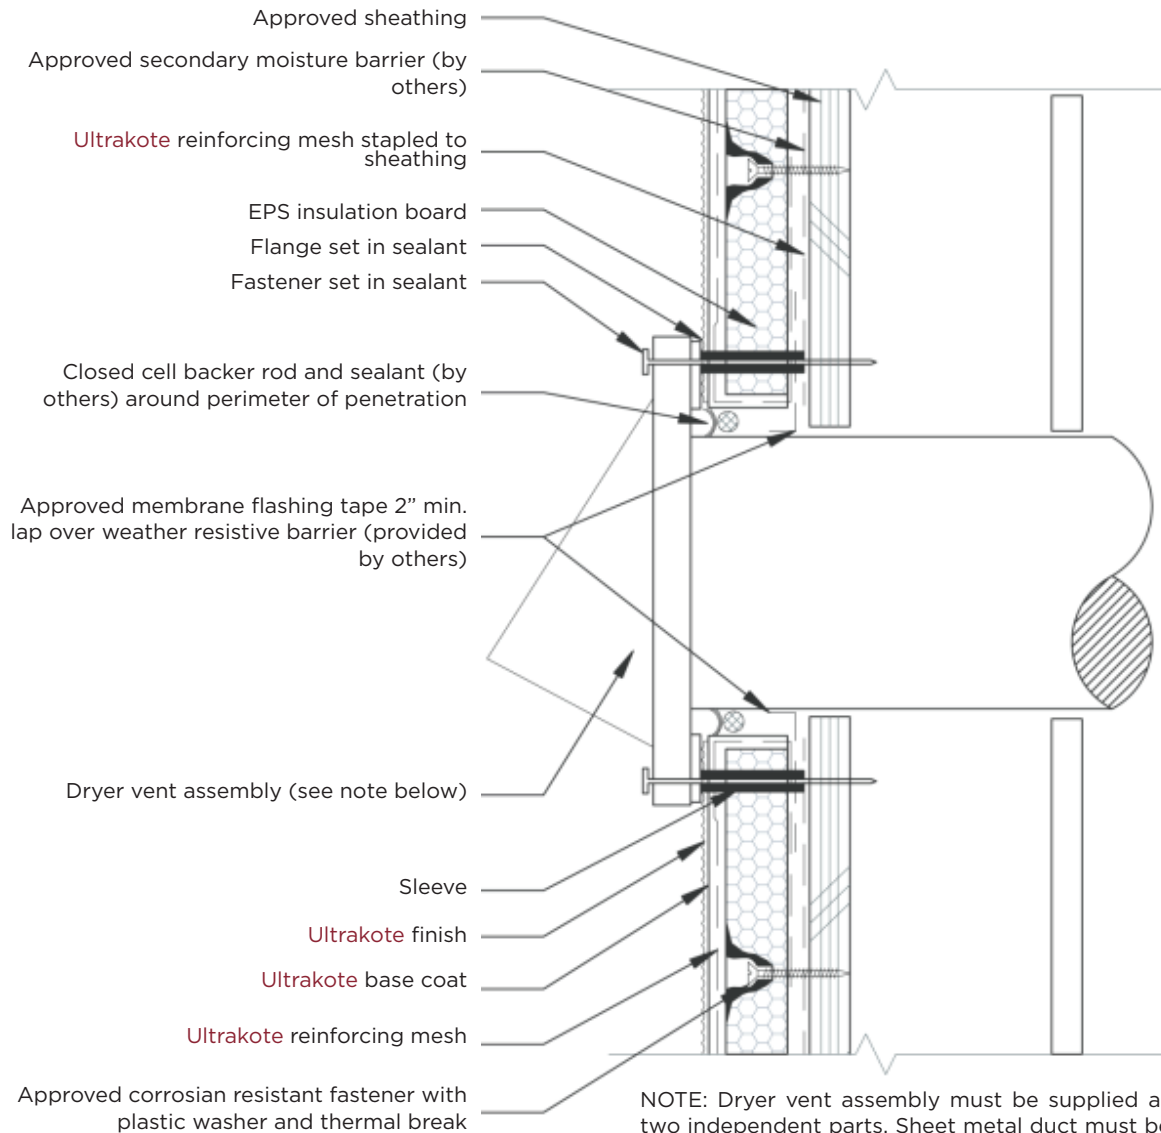

NOTE: Dryer vent assembly must be supplied as two independent parts. Sheet metal duct must be installed prior to EIFS installation. To install membrane flashing tape seal backer rod and sealant must be applied prior to dryer vent cover attachment.